



# Master Time Center


Control Center for Multifunctional Time Distribution Systems and Mains Frequency Supervision

## Master Time Center

Flug Flight	nach to	über via	planm. scheduled	verspätet delayed	Schalter Counter
LH 1022	STUTT GART	HBF .	935		-
AF 1701	LYON		940		683-686
AY 822	HELSINKI		940		113-338
AA 071	SFRANCISCO-DALLAS		945		731-739




Railway Stations

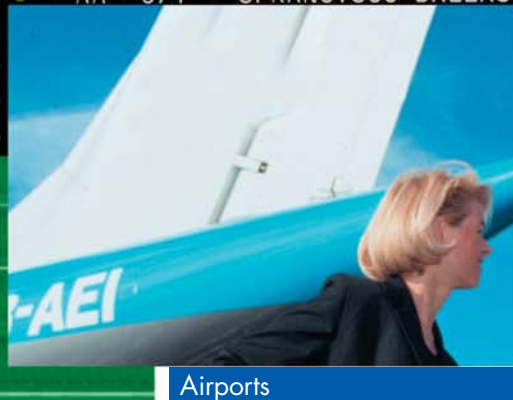

Airports



Power Stations

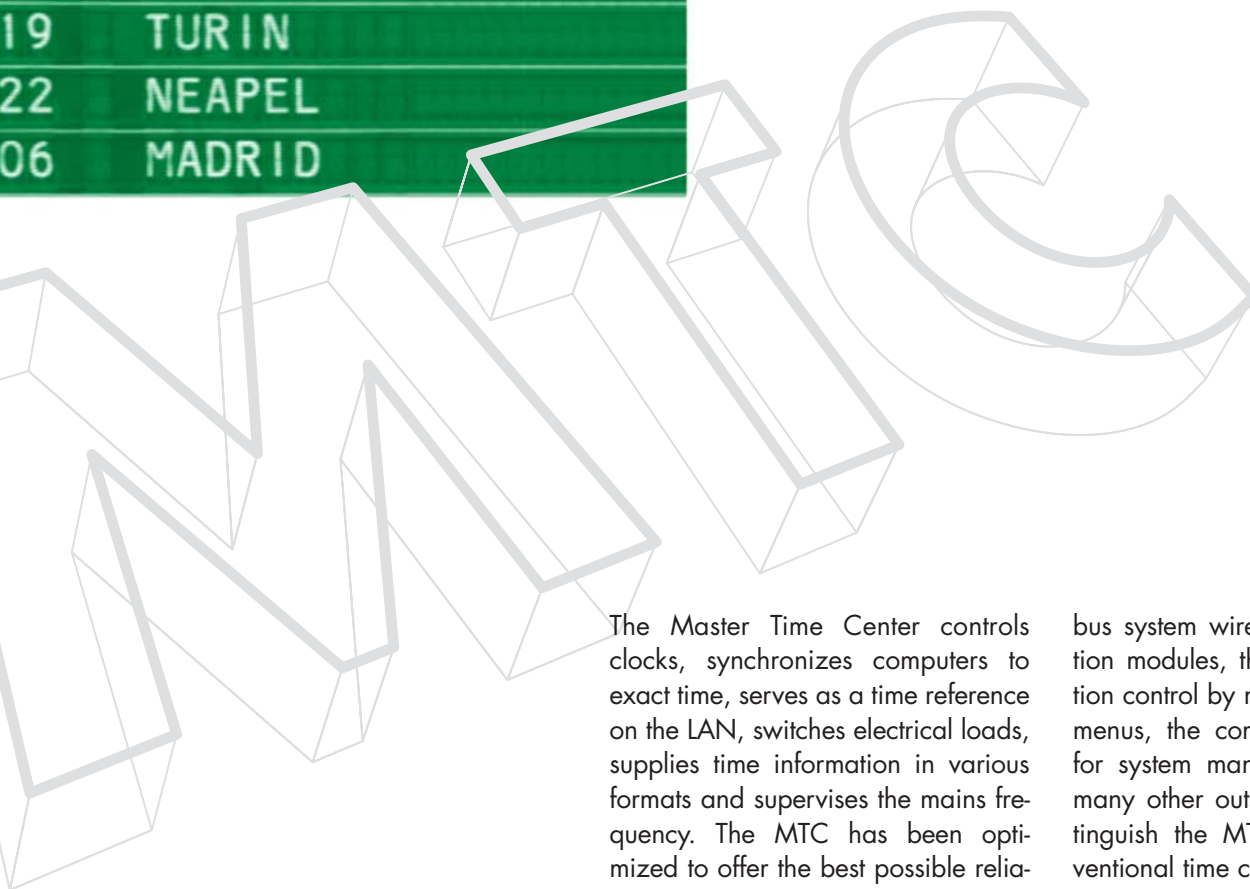

The Master Time Center controls clocks, synchronizes computers to exact time, serves as a time reference on the LAN, switches electrical loads, supplies time information in various formats and supervises the mains frequency. The MTC has been optimized to offer the best possible reliability and flexibility, in order to produce specific and flexible system-solutions for time distribution, in industries, airports, railways, radio-TV stations, hospitals, power stations and scientific laboratories. The reliable, internal

bus system wire, the intelligent function modules, the centralized operation control by means of user friendly menus, the comprehensive software for system management as well as many other outstanding features distinguish the MTC system from conventional time centers.


## MTC Operation and design

### Operation Terminal


Notebook-PC in lockable drawer or external PC



### Remote Operation Terminal

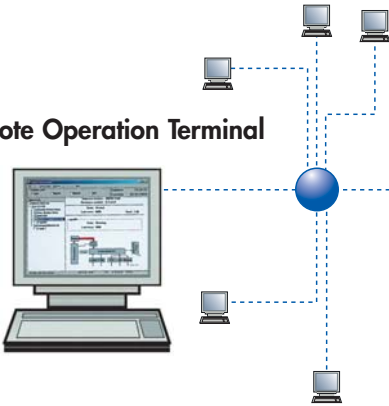

- Comprehensive information about operations
- Versatile Configuration

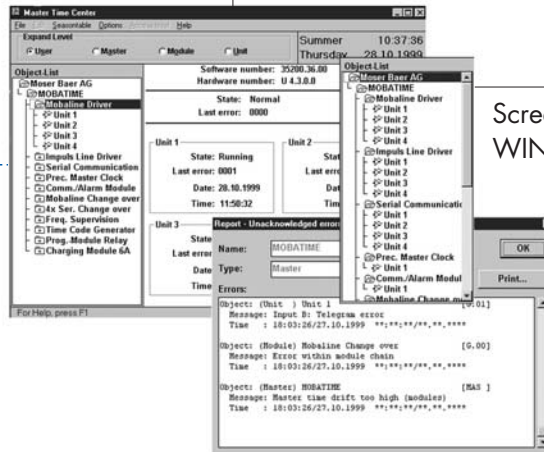


Screen-shots of WINDOWS environment

Detailed alarm messages

### MTC housings

- 19"-wall cabinet MTC 16 with lockable glass front door.  
W x H x D: 600 x 478 x 415 mm
- Version MTC 50 for large installations for up to 100 slave clock lines and more.  
B x H x T: 600 x 612 x 415 mm
- MTC 50 also as 19"-cabinet available.

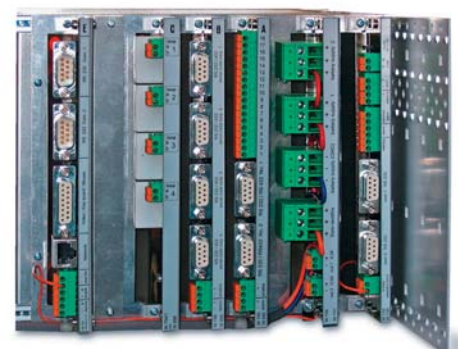


### Electrical connections on the rear side

On each module individual plug-in connectors, screw or spring terminals.


## Time Distribution System

- Construction of versatile systems for specific applications by means of various modules
- Conventional impulse slave clocks
- Self-setting MOBALine slave clocks
- NTP Time server V4
- Computer synchronization by serial interfaces
- Synchronization of electrical devices and installations by means of various time codes
- Remote relays switching through time program
- Analogue and Digital Clocks
- Alarm reporting by SNMP-Traps V1, e-mail

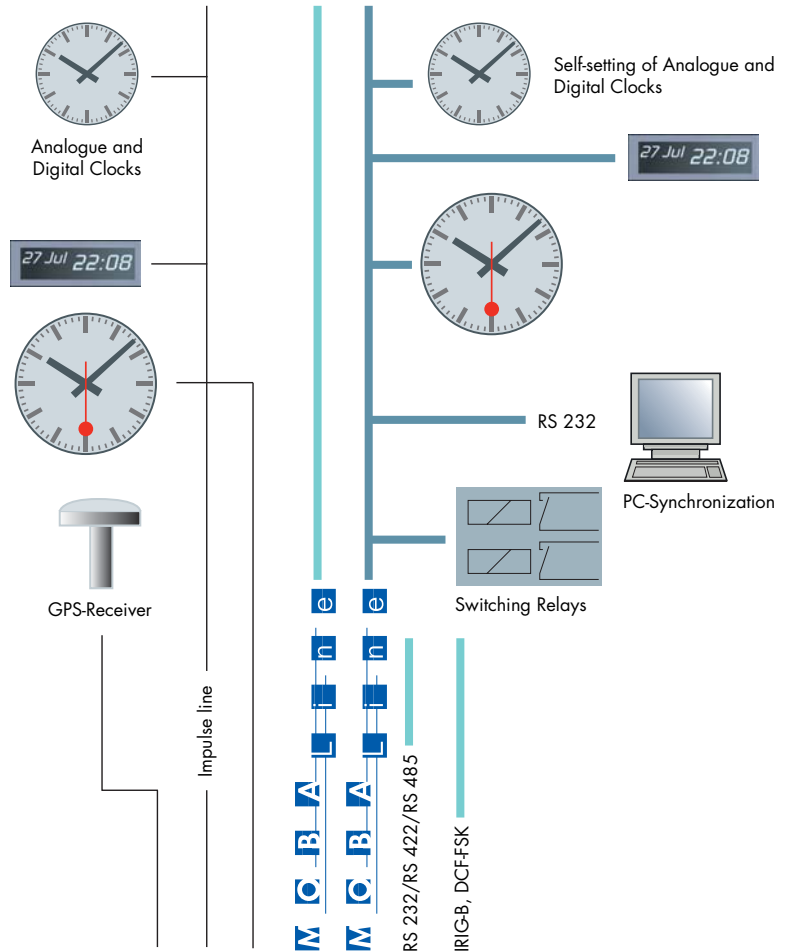

Operation terminal

U 2.2.0 Terminal Adapter
U 1.1.0 Master 2
U 5.0.0 Charging Module
U 1.2.1 Prec. Master Clock
U 4.0.0 Impulse Line Driver
U 4.0.0 Impulse Line Driver
U 4.3.0 MOBALine Driver
U 4.3.0 MOBALine Driver
U 4.1.0 Serial Communication
U 4.2.0 Time Code Generator

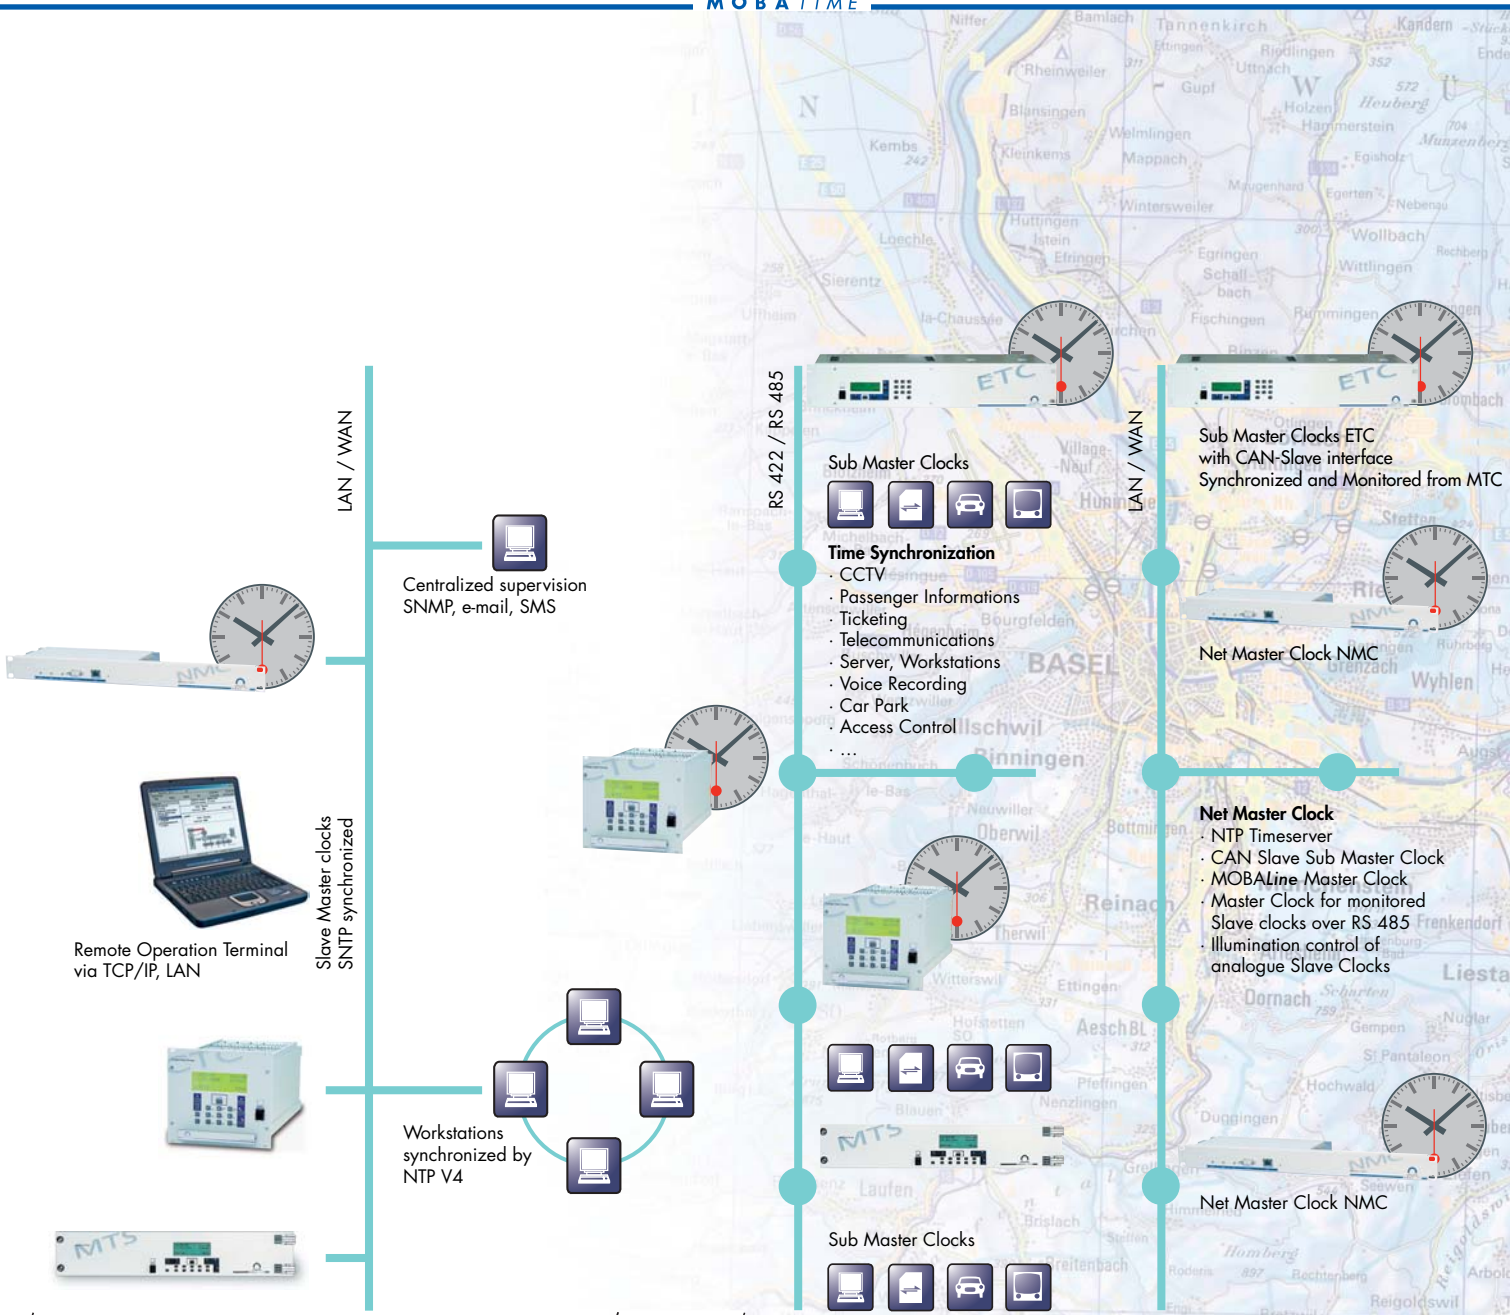

U 1.3.x Network Processing Module

U 6.3.0 Com. and Alarm Serial

U 6.5.0 Com. and Alarm Network

Reserved for Extension

Reserved for Extension

Reserved for Extension


Reserved for Extension

B 24-7 Battery Supply


## Mains Frequency Supervision

- Precise measurement and log of mains frequency (50/60 Hz)
- Signalling of deviation
- Various programmable alarm limit values
- Values displayed on terminal, built-in LCD or remote LED display

Local Time	09:07:03
System Date	18:06:04
Mains Time	09:07:03
Time Deviation [s]	-000.078
Frequency 1 [Hz]	49.998
Freq. Change [mHz/s]	-035

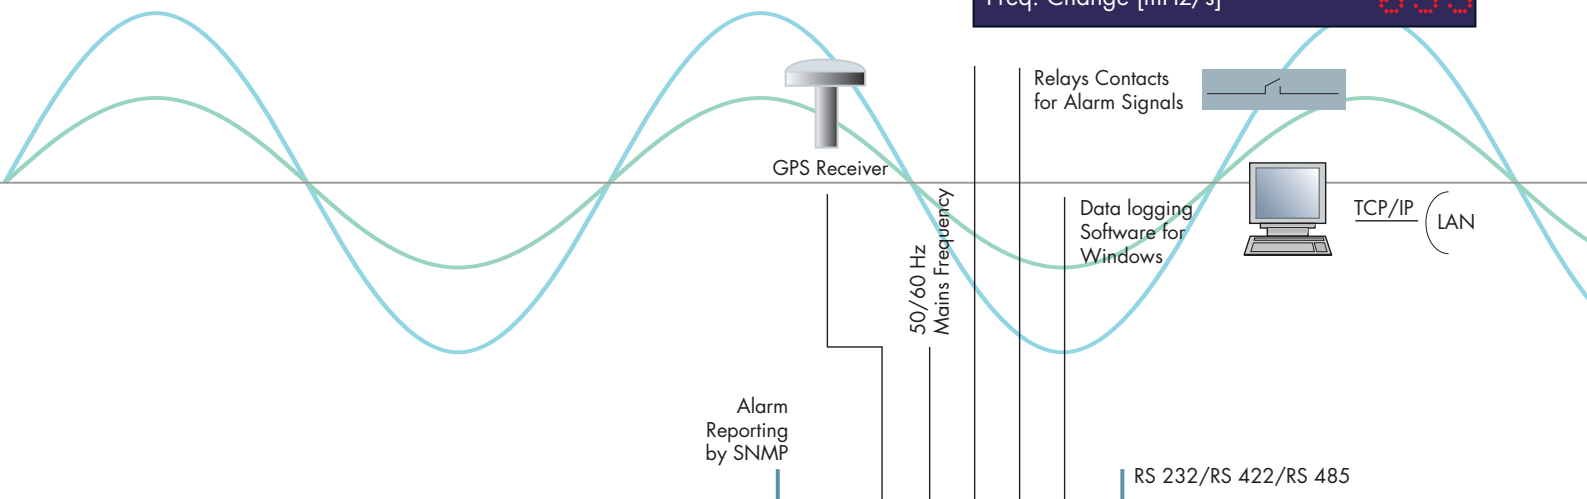

Operation terminal

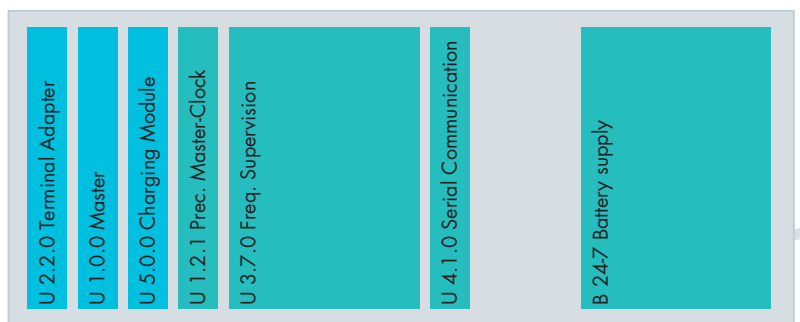


```

FREQUENCY      49.998
TIME DEV.      -000.078
LOCAL TIME     09:07:03
MAINS TIME     09:07:03
  
```

## System structure

- An MTC installation is composed of systems, modules and units, hierarchically organized.
- A unit controls and monitors inputs and outputs. e.g. impulse or MOBALine clock lines, Ethernet connection with it's numerous services, serial outputs, time code generators, etc.
- One or several units of the same type are included in one module. e.g. U 4.0.0 with four impulse lines, U 4.1.0 with four serial outputs. A module is composed of single or multiple boards. For system operational reliability and security each module fulfills its task independently.
- The master and modules together make a system. All modules have identical priorities and communicate in a polling procedure with the master. It communicates over an internal 2-wire-bus with optocoupler-isolation to / from each module. No connected module is able to block a the communication. The system is mounted in a 19" rack, with indicators for power, regular operation, alarms and DCF signal. System operation is performed by PC terminal.
- The complete MTC system can be expanded with an almost unlimited number of sub-systems by means of the industrial 2-wire-bus LON™ (Local Operation Network).

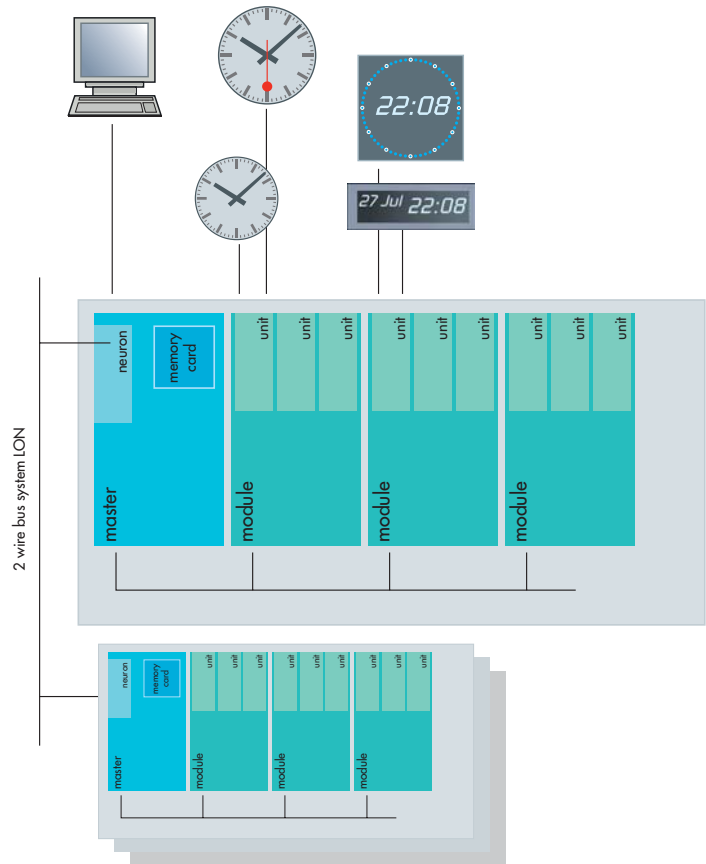

## Versatile modules for all applications

- **U 1.1.0 Master 2**  
Time synchronization, supervision and control of all modules, communicating with PC terminal and with other systems. The software is saved on an extractable memory-card. The software is automatically downloaded to modules.
  - **U 2.2.0 Terminal Adapter**  
Display for «alarm», «warning» and «regular operation» by lamps LED's. RS 232 adapter between the master and PC-terminal. RS 232 interface for protocol printer. In each MTC system (19" sub-rack) a terminal adapter U 2.2.0. is required.
  - **U 5.0.0 Charger (charging-controller)**  
Automatic charging of 24 or 48 V lead-acid batteries. Charging current 6 A max. Supervision of voltage, current and temperature. Several U 5.0.0 may be used in parallel connection for current increase.
  - **U 1.2.x Master Clock**  
Inputs for different external time sources: GPS 3000, DCF, IRIG-B and DCF-FSK (option), serial time telegrams RS 232/RS 422. Four outputs with periodical impulses or frequencies. High Precision Master clock with accurate time base for stand alone operation (+/- 0.001 s/day).
  - **U 1.3.x Network Processing Module**  
Connection via TCP/IP, Ethernet to LAN/WAN. Numerous services: NTP V4-server, NTP-client (as MTC's master clock), SNMP-traps V1/ e-mail alarm reporting, remote operation control.
  - **U 3.5.0 MOBALine Switchover Module**  
Supervision of 2x4 MOBALine slave clock lines. Automatic or manual switchover of 4 outputs.
  - **U 3.6.x Serial Switchover Module**  
Supervision of 2x2 (U 3.6.0) or 2x4 (U 3.6.1) serial outputs RS 232/RS 422. Automatic or manual switchover of respectively 2 or 4 outputs.
  - **U 3.7.1 Precision Frequency Supervision**  
Measurement, averaging and supervision of mains frequency (50/60 Hz). Programmable limit values for alarm messages. Four serial outputs for frequency, frequency deviation, frequency time, etc...
  - **U 4.0.0 4x Impulse Line Driver**  
Four impulse clock lines. Each line may be adjusted as a minute, half-minute, 1/8 minute or second line. Measurement and supervision of impulse voltage and impulse current.
  - **U 4.1.0 4x Serial Communication**  
Four serial RS 232 or RS 422 outputs of time and date information. The telegram format and transmission parameters are freely configurable.
  - **U 4.2.0 Time-Code-Generator**  
Four audio frequency time code outputs, configurable as standard time code IRIG-B, IRIG-E, AFNOR or DCF-FSK. Four opto-coupler outputs, selectable for DCF/DC time code or periodical impulses. Two digital demodulated time code outputs
- (1 x IRIG-B and 1 x IRIG-E) 5 V 50 ohms. Measurement and supervision of output signals.
- **U 4.3.0 4x MOBALine Driver**  
Four MOBALine clock lines for MOBALine devices as self-setting clocks, computer interfaces and channel relays. Measurement and supervision of line voltage and line current.
  - **U 6.3.0 Communication and Alarm Serial CAS**  
Time synchronization and supervision of up to 16 remote master clocks (CTC, MTS, ETC) via a serial protocol, connected to available communications lines RS 232/RS 485.
  - **U 6.5.0 Communication and Alarm Network CAN**  
Time synchronization and supervision of up to 16 remote master clocks (NMC, ETC) via LAN/WAN communication.
  - **U 9.0.0 Program Module**  
16 free selectable signaling and switching circuits by potential free relay's contacts. PC-Software for programming.